


"BW" SPACING AND "H" ARE SPECIFIED ON DRAWINGS OR SPECIAL CONDITIONS.

BARRIER SCREEN MATERIALS WILL BE SPECIFIED ON THE DRAWINGS. IF NOT STATED ASSUME #8 REBAR. ALL JOINTS ARE WELDED.

THESE DEVICES SHOULD BE SET UPSTREAM OF THE CULVERT A MINIMUM DISTANCE OF 1.5 TIMES THE PIPE DIAMETER.

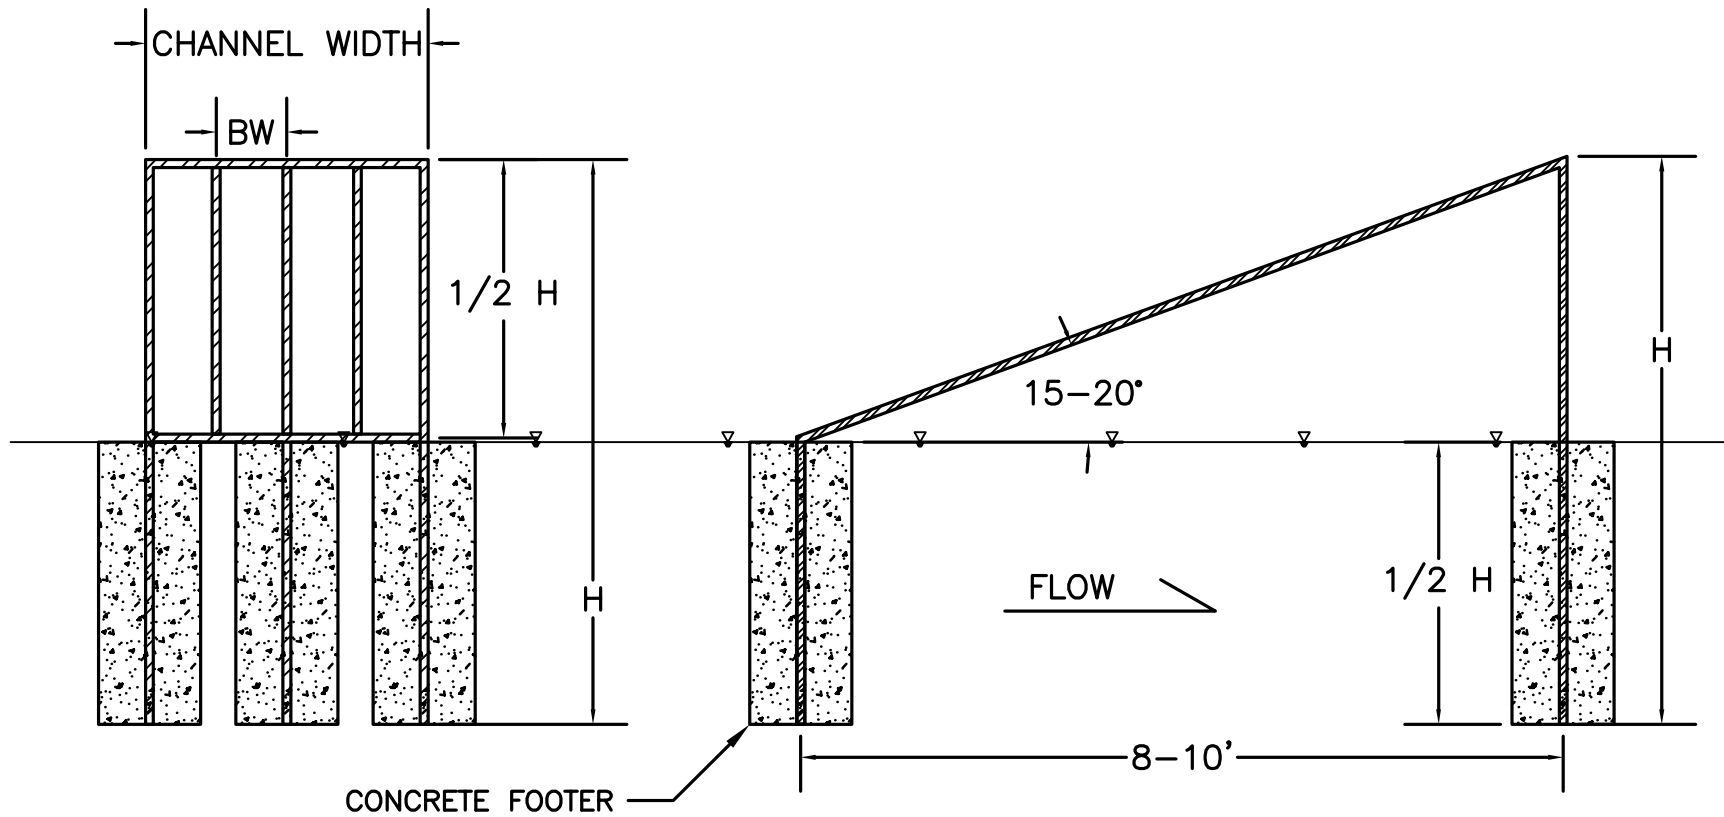

IN-STREAM CULVERT DEBRIS BARRIER (AML 23-60-2)